Yellowstone City-County **Health Department**

123 South 27th • P.O. Box 35033 • Billings, MT 59107

PERMIT

SUBSURFACE ON-SITE SEWAGE TREATMENT SYSTEM

Environmental Health Program, Courthouse Room 308
256-2770

Date: 5-23-07 Application Number #: 07-94

YCCHD Permit #: 13946

Site Location: 4541 HUNTINGTON HILLS ROAD

Legal Description: SEC 11 T1 SOUTH R 8 E Lot ____ Block ____ Tract ____

Installer: PFIEFLE

Installed for: WALT FAIRFAX

Type of Dwelling: SFR Constructed for: 2 bedrooms / ____ gal/day.

Minimum Drainfield Size Requirements: 125 square feet/bedroom.

Total minimum amount of drainfield to be installed: 250 square feet; or 84 lineal feet x 3' WIDE

Percolation Rate EST minutes/inch Bedrock Depth 78' feet Groundwater Depth >78' feet.

Water Supply: Well ____ Cistern(s) X Public ____ Other ____

Distance to Septic Tank ____ Distance to Drainfield ____

Layout Details:

Tank Size: ____1000 ● 1500 ____2000 gallons; other RISERS, DOSE TANK W/pump

Material: Concrete ● Other ____ Tank to Foundation: ~7'

Effluent Filter: Yes/No

Trench Dimensions:

Gravel above pipe: NA Depth to perf. pipe: NA

Gravel below pipe: NA Depth to bottom trench: 24-30"

Trench width: 36" Trench to Property Line: NOT MEASURED

System Type: PRESSURE DOSED CHAMBERS Latitude: N45° 45' 37.4"

Total Area Installed: 84' x 3' = 252 FT² Longitude: W104° 21' 39.1"

pressure DOSED AT TIME OF INSPECTION

SQUIRT HEIGHT 5'

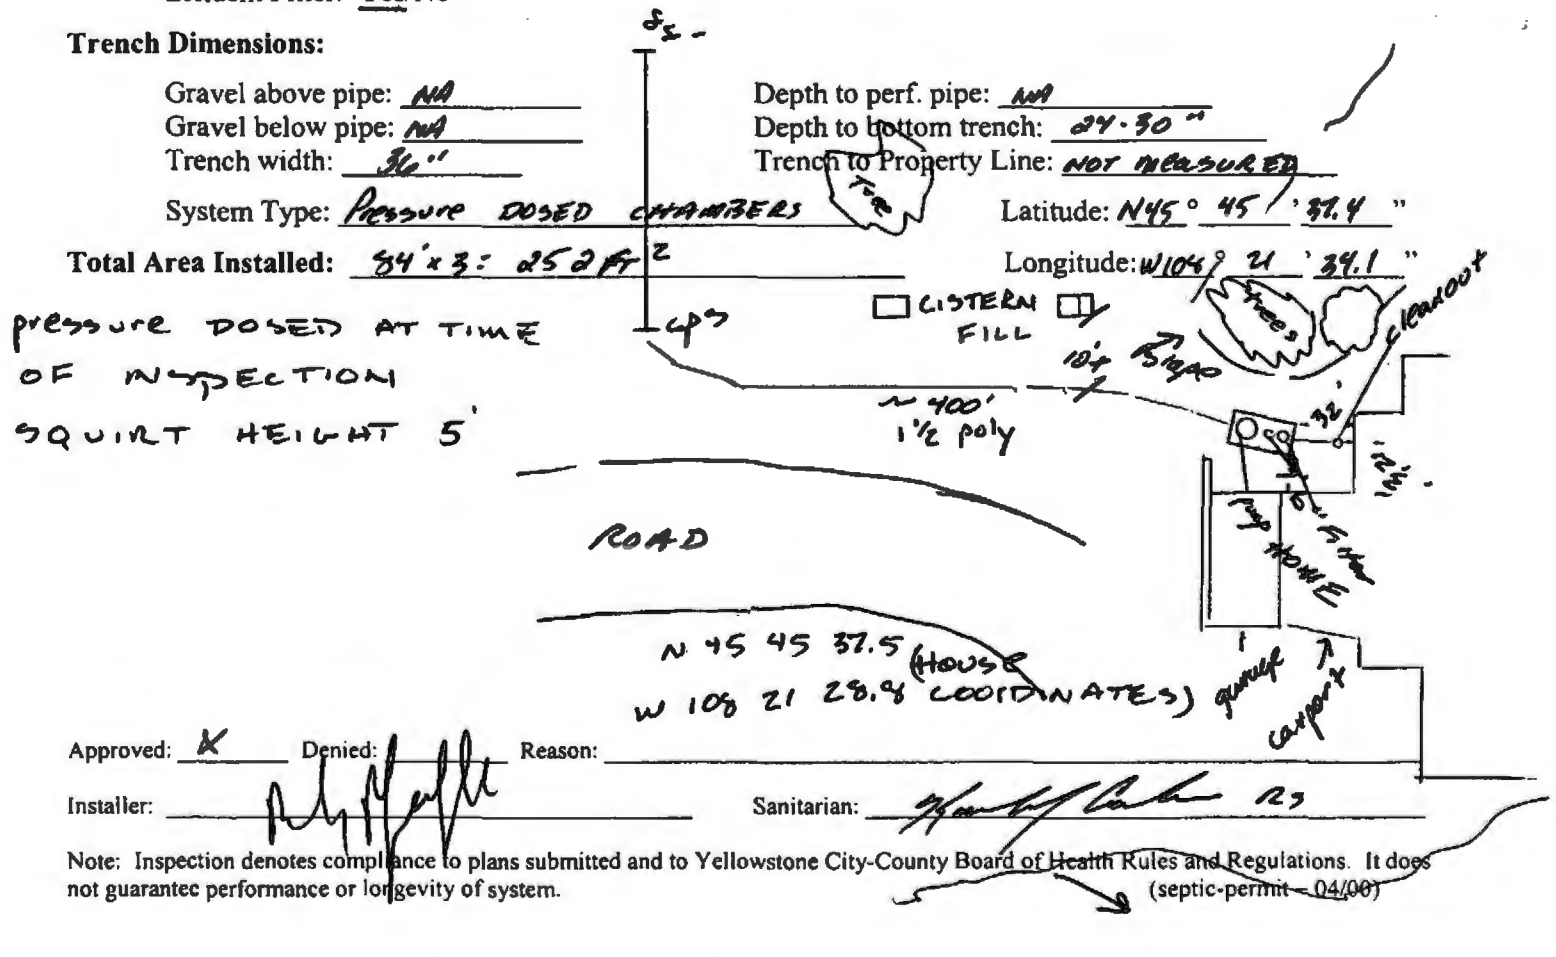

Approved: X Denied: ____ Reason: ____

Installer: ____ Sanitarian: ____

Note: Inspection denotes compliance to plans submitted and to Yellowstone City-County Board of Health Rules and Regulations. It does not guarantee performance or longevity of system.

(septic-permit—04/00)